




SRI BAALAMURUGAN BOREWELLS

Hennur-Bagalur Road, opp. Vijaya Bank, Kothanur, Bangalore
Mob. : 9845020536, 9901920004

WORK REPORT

To AEE. Beatazamaqura Sub division. BBMP. Ward no. 05 Positiv Layout			No. : 345	
			Date : 19/5/16	
S.No.	Particulars	Rft	Water Yeild	Remarks
1.	Size of the Borewell	165mm		
2.	Total Deapth of the Borewell	1192'		
3.	MS Casing Erected	142'		
4.	1st Water Source at the Deapth	372'		
5.	2nd Water Source at the Deapth	609'		
6.	3rd Water Source at the Deapth	920'		
7.	4th Water Source at the Deapth	1120'		
8.	If any Silt, Boulders at the Deapth	Ab.		
9.	Nature of Water	Normal		
10.	Motor Pump to be used	Yes		
11.	Any other Remarks	-		
12.	Total Yeild of the Borewell		3'	

Thanking You


Yours faithfully
For Sri Baalamurugan Borewells



SRI BAALAMURUGAN BOREWELLS

Hennur-Bagalur Road, opp. Vijaya Bank, Kothanur, Bangalore

Mob. : 9845020536, 9901920004

WORK REPORT

To		No. : 344		
AEE. Baalamurugan Sub Division BBMP. Ward no. 05 Praburani Layout (Kosur)		Date : 19/5/16		
S.No.	Particulars	Rft	Water Yeild	Remarks
1.	Size of the Borewell	165mm		
2.	Total Deapth of the Borewell	1188'		
3.	MS Casing Erected	136'		
4.	1st Water Source at the Deapth	350'		
5.	2nd Water Source at the Deapth	610'		
6.	3rd Water Source at the Deapth	930'		
7.	4th Water Source at the Deapth	1110'		
8.	If any Silt, Boulders at the Deapth	- NO -		
9.	Nature of Water	Normal		
10.	Motor Pump to be used	Yes		
11.	Any other Remarks			
12.	Total Yeild of the Borewell		2 1/2"	

Yours faithfully

For Sri Baalamurugan Borewells

Thanking You



SRI BAALAMURUGAN BOREWELLS

Hennur-Bagalur Road, opp. Vijaya Bank, Kothanur, Bangalore

Mob. : 9845020536, 9901920004

WORK REPORT

To		No. : 343		
AKK. Beataarayamanna Sub division BBMP ward no. 05 Srinivasapura layout Channarayana		Date : 19/05/16		
S.No.	Particulars	Rft	Water Yeild	Remarks
1.	Size of the Borewell	168mm		
2.	Total Deapth of the Borewell	1169'		
3.	MS Casing Erected	161'		
4.	1st Water Source at the Deapth	380'		
5.	2nd Water Source at the Deapth	610'		
6.	3rd Water Source at the Deapth	920'		
7.	4th Water Source at the Deapth	1050'		
8.	If any Silt, Boulders at the Deapth	No		
9.	Nature of Water	Normal		
10.	Motor Pump to be used	Yes		
11.	Any other Remarks	-		
12.	Total Yeild of the Borewell		3'	

Thanking You

Yours faithfully

For Sri Baalamurugan Borewells



SRI BAALAMURUGAN BOREWELLS

Hennur-Bagalur Road, opp. Vijaya Bank, Kothanur, Bangalore

Mob. : 9845020536, 9901920004

WORK REPORT

To AEE Beataarayana para Sub Division BBMP Ward no. 05 Babaganagara			No. : 342	
			Date : 19/5/16	
S.No.	Particulars	Rft	Water Yeild	Remarks
1.	Size of the Borewell	165mm		
2.	Total Deapth of the Borewell	1190'		
3.	MS Casing Erected	152'		
4.	1st Water Source at the Deapth	381'		
5.	2nd Water Source at the Deapth	620'		
6.	3rd Water Source at the Deapth	940'		
7.	4th Water Source at the Deapth	1100'		
8.	If any Silt, Boulders at the Deapth	no		
9.	Nature of Water	Normal		
10.	Motor Pump to be used	yes		
11.	Any other Remarks			
12.	Total Yeild of the Borewell		2 1/2"	


Yours faithfully

Thanking You

For Sri Baalamurugan Borewells



SRI BAALAMURUGAN BOREWELLS

Hennur-Bagalur Road, opp. Vijaya Bank, Kothanur, Bangalore
Mob. : 9845020536, 9901920004

WORK REPORT

To AEE. Byatarayanapura Sub division BBMP. Ward No. 05 Shivapura.			No. : 337	
			Date : 19/5/16	
S.No.	Particulars	Rft	Water Yeild	Remarks
1.	Size of the Borewell	165mm		
2.	Total Deapth of the Borewell	1170'		
3.	MS Casing Erected	162'		
4.	1st Water Source at the Deapth	320'		
5.	2nd Water Source at the Deapth	670'		
6.	3rd Water Source at the Deapth	920'		
7.	4th Water Source at the Deapth	1050'		
8.	If any Silt, Boulders at the Deapth	- NO -		
9.	Nature of Water	Normal		
10.	Motor Pump to be used	Yes		
11.	Any other Remarks	-		
12.	Total Yeild of the Borewell		2 1/2"	


Yours faithfully

For Sri Baalamurugan Borewells

Thanking You

GROUND WATER SURVEY REPORT

OPEN WELL/ BOREWELL DATA OF SURVEY

- a) Name of the Party : B&M P
 b) Location of the Site : AFK, Byatarayanapura
Sub Division
 c) Area of the land : Ward no. 05
Babaganagara

INVESTIGATION REPORT

- 1) GEOLOGY OF THE AREA : Free Gravelly Main
 2) Recommended Site for drilling : 1100' - 1200'
 3) Total depth to be drilled : 140' - 180'
 4) Approx. casing pipe required : 140' - 180'
 5) No. of water bearing Zones : 5
 6) No. of favourable spots marked : 1
 7) Qty. of water expected : 2' to 3'
 8) Method of survey carried out : Free Rediason method
 9) Remarks : 6 1/2' over borehole as

Water Level between


52' - 810'

[Signature]

HYDROGEOLOGIST

(M.G. RAJASHEKHAR, M.Sc., DEG., F.G.S.)

BOREWELL SITE PLAN

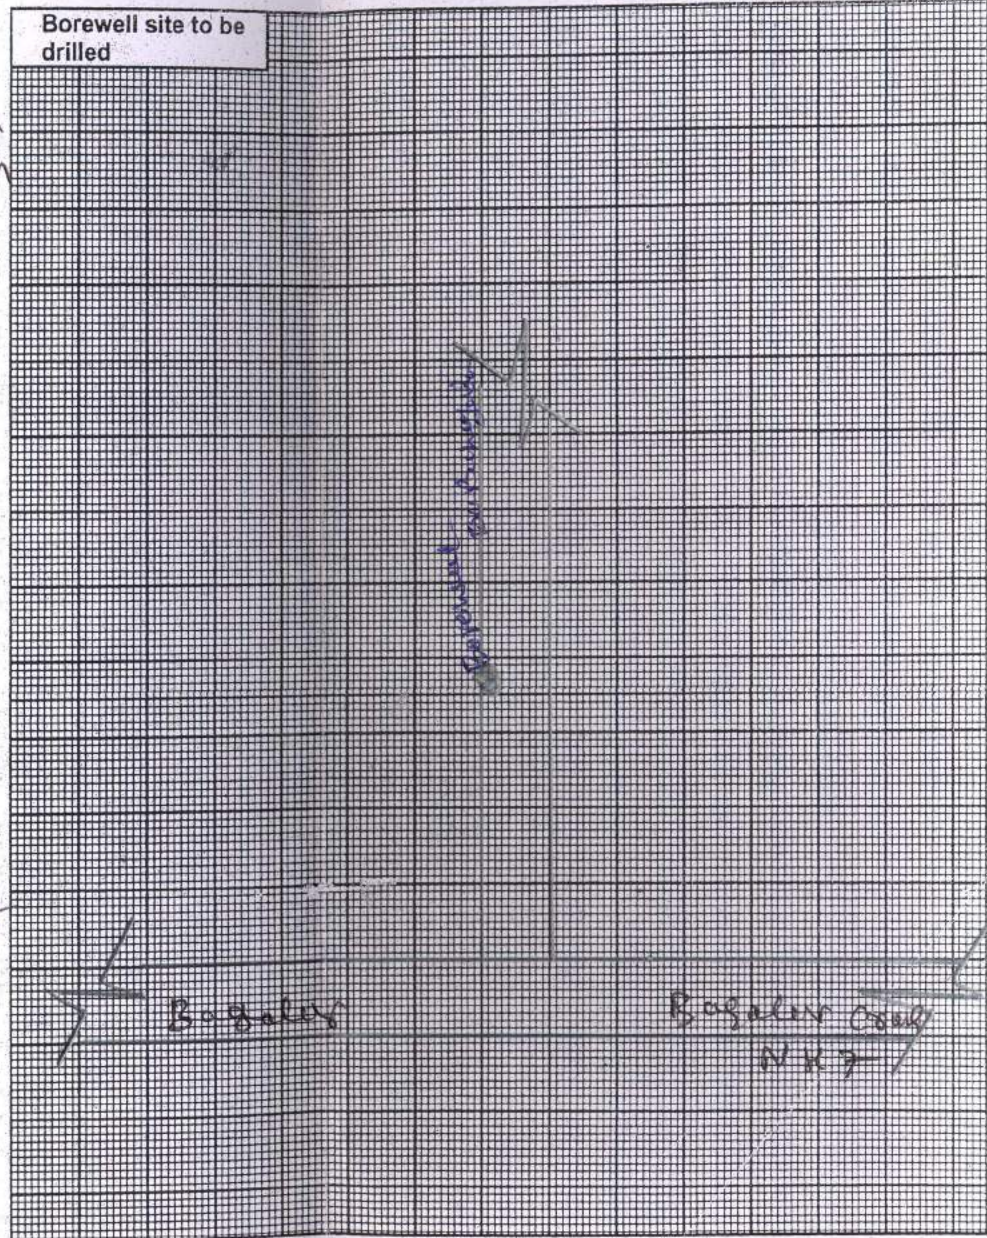

GROUND WATER SURVEY REPORT

OPEN WELL/ BOREWELL
DATA OF SURVEY

BBMP

a) Name of the Party

: AEE, Byatarayanapura

b) Location of the Site

: Ward no. 05
8th division

c) Area of the land

: Shivaraja (Shivarajanna)
Backside

INVESTIGATION REPORT

1) GEOLOGY OF THE AREA

: Geo. Menara MP

2) Recommended Site for drilling

: ward no. 05

3) Total depth to be drilled

: 1100' - 1200'

4) Approx. casing pipe required

: 100' - 110'

5) No. of water bearing Zones

: - 5 -

6) No. of favourable spots marked

: - 1 -

7) Qty. of water expected

: 2 1/2' to 3'

8) Method of survey carried out

: Geo. Peddannaiah method

9) Remarks

: 6 1/2" dia. Bore well as


Water line shown

ON 100' - 800'
Assistant Executive Engineer
Byatarayanapura Sub Division
B.B.M.P. Bangalore

[Handwritten signature]

HYDROGEOLOGIST
(M.G. RAJASHEKHAR, M.Sc., DEG., F.G.S.)

BOREWELL SITE PLAN

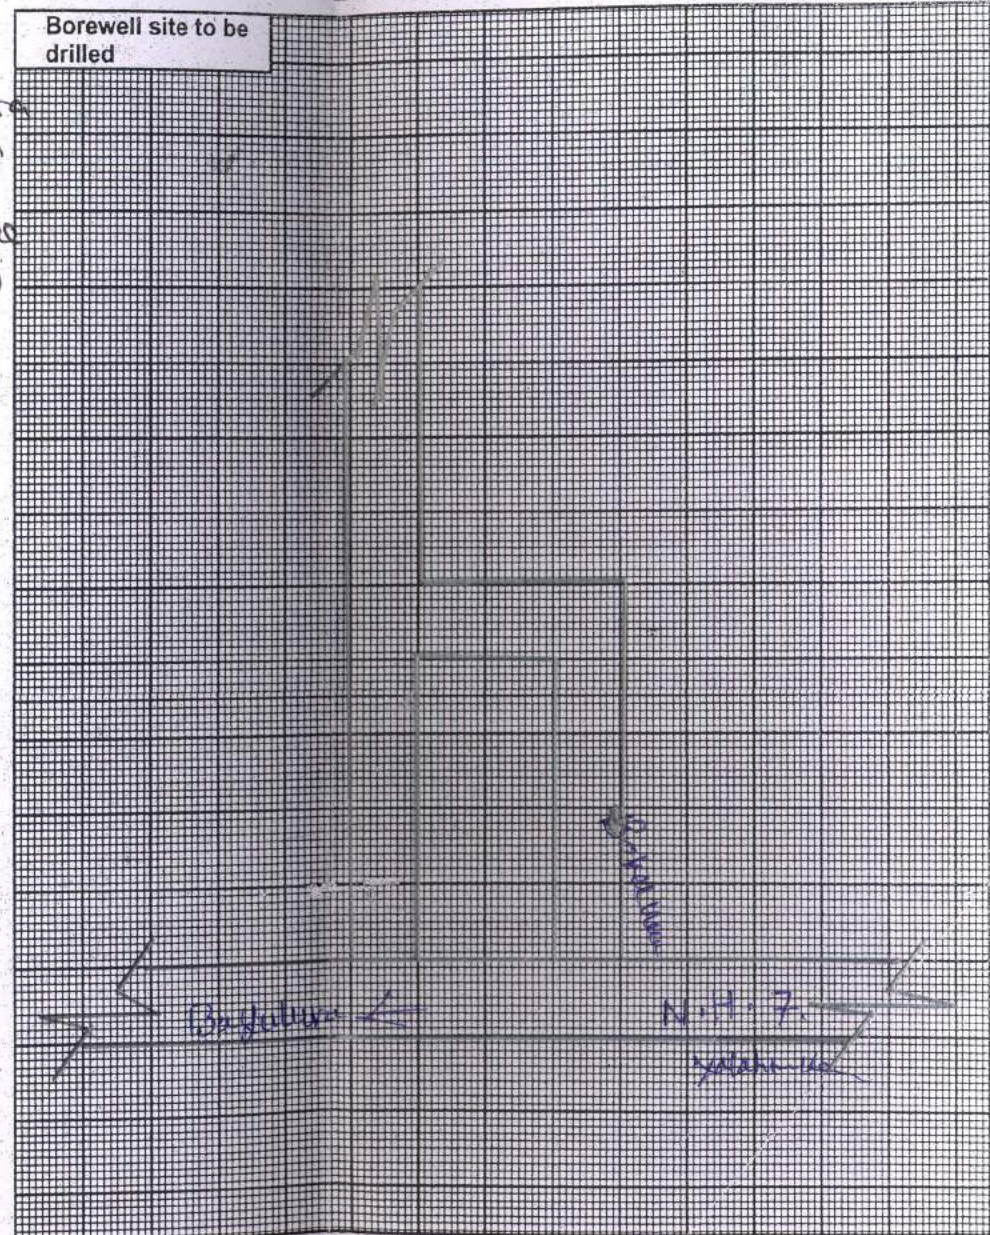

GROUND WATER SURVEY REPORT

OPEN WELL/ BOREWELL DATA OF SURVEY

- a) Name of the Party : B.B.M.P.
 b) Location of the Site : REE. Byatavayanapura
Ward no. 05
 c) Area of the land : 1000 sq. ft.

INVESTIGATION REPORT

- 1) GEOLOGY OF THE AREA : Red granite gneiss
 2) Recommended Site for drilling : ward no. 05
 3) Total depth to be drilled : 1150' - 1200'
 4) Approx. casing pipe required : 140' - 150'
 5) No. of water bearing Zones : 5
 6) No. of favourable spots marked : 1
 7) Qty. of water expected : 2 1/2' - 3'
 8) Method of survey carried out : Red granite gneiss
 9) Remarks : 6 1/2' over fine well as


Alaser line below

135' - 800'

[Signature]

HYDROGEOLOGIST
(M.G. RAJASHEKHAR, M.Sc., DEG., F.G.S.)

BOREWELL SITE PLAN

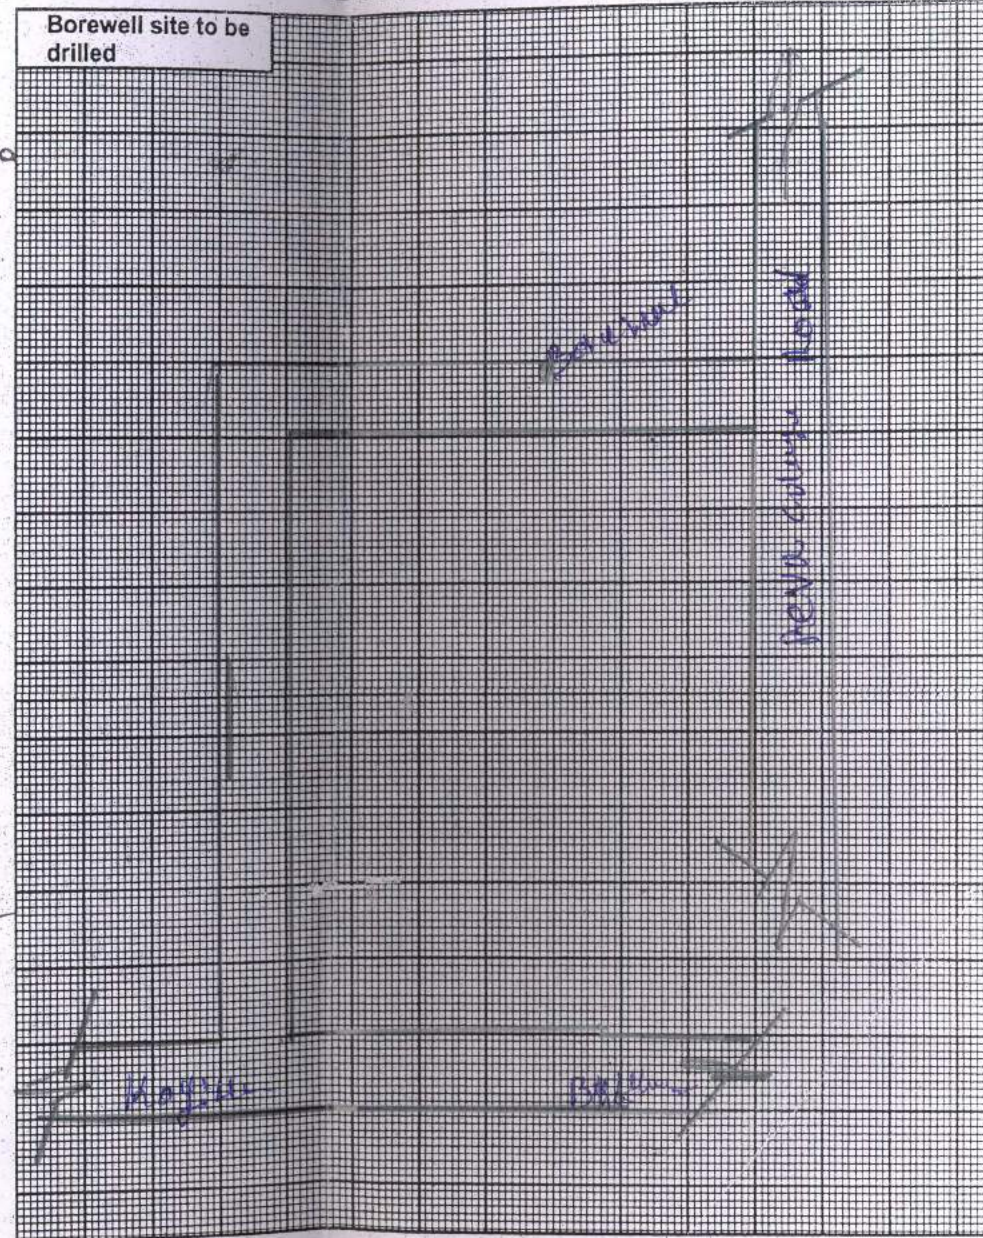

Assistant Executive Engineer
Byatavayanapura Sub Division
B.B.M.P. Bangalore

GROUND WATER SURVEY REPORT

OPEN WELL/ BOREWELL DATA OF SURVEY

a) Name of the Party

: B.M.P.

b) Location of the Site

: ARE - Byatarayanapura
Sub Division

c) Area of the land

: Ward no. 05
Prakrushi layout

INVESTIGATION REPORT

1) GEOLOGY OF THE AREA

: Green hardwore rock

2) Recommended Site for drilling

: Ward no. 05

3) Total depth to be drilled

: 1000' - 1050'

4) Approx: casing pipe required

: 100' - 105'

5) No. of water bearing Zones

: 5

6) No. of favourable spots marked

: 1

7) Qty. of water expected

: 2' to 3'

8) Method of survey carried out

: Geo pedimeter method

9) Remarks

: 6 1/2" down hole well as

Alaser line Segue


onl

1030' - 200'

Assistant Executive Engineer
Byatarayanapura Sub Division
B.M.P. Bangalore
Terms & Conditions

HYDROGEOLOGIST
(M.G. RAJASHEKHAR, M.Sc., DEG., F.G.S.)

BOREWELL SITE PLAN

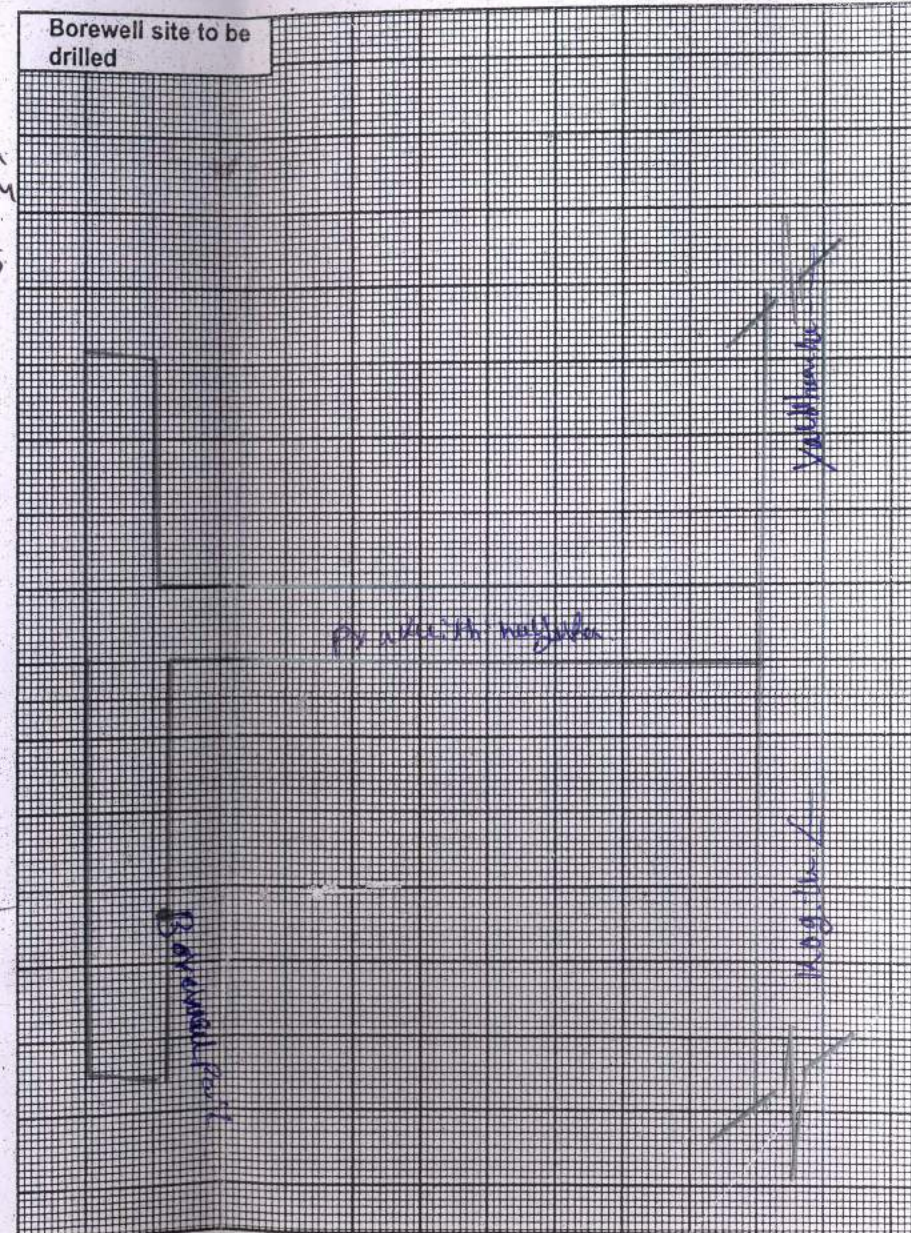

GROUND WATER SURVEY REPORT

OPEN WELL/ BOREWELL DATA OF SURVEY

- a) Name of the Party : BBMP
 b) Location of the Site : AER. Beatayanapura
 c) Area of the land : Ward no. 05
Srinivasa pura colony
(Yamanna Tank)

INVESTIGATION REPORT


- 1) GEOLOGY OF THE AREA : Gr. basaltic mb.
 2) Recommended Site for drilling : Ward no. 05
 3) Total depth to be drilled : 1080' - 1100'
 4) Approx. casing pipe required : 100' - 105'
 5) No. of water bearing Zones : 5
 6) No. of favourable spots marked : 1
 7) Qty. of water expected : 2' to 3'
 8) Method of survey carried out : Gr. basaltic mb.
 9) Remarks : 8 1/2" dia. bore well

Water line between
Ch. - 800'

Executive Engineer
 Assistant Engineer
 Beatayanapura Sub. Division
 B.B.M.P. Bangalore

HYDROGEOLOGIST
 (M.G. RAJASHEKHAR, M.Sc., DEG., F.G.S.)

BOREWELL SITE PLAN

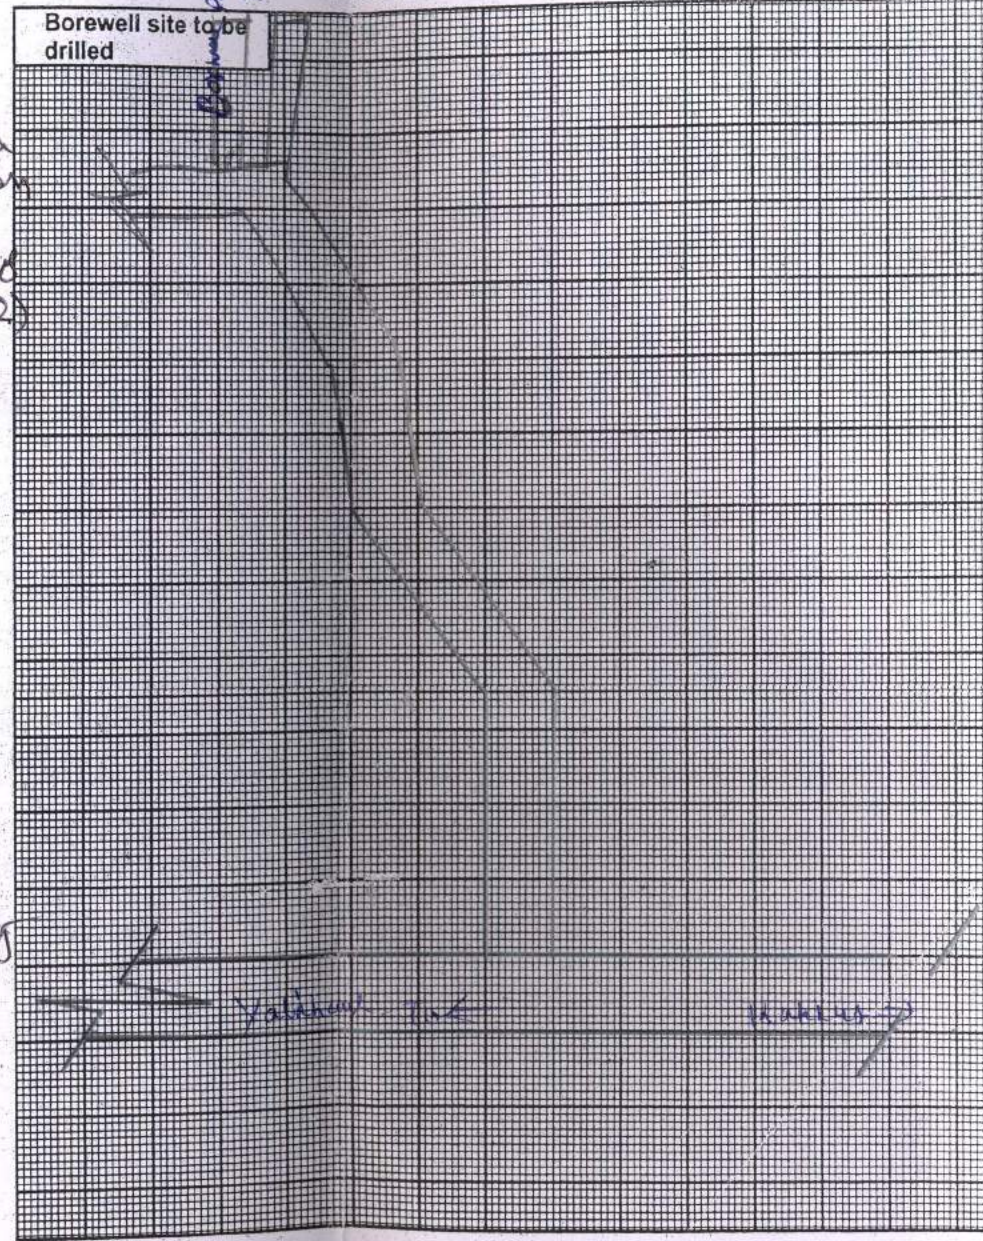

For Landis+Gyr Limited.

One Hundred Rupees Only

WILSON JAY COMPANY LTD
BANGALORE ELECTRIC

TAX INVOICE

dis+Gyr Limited

ಎಡಿಸ್+ಗೇರ್ ಲಿಮಿಟೆಡ್

Landis+Gyr+

Branch Office

O/o Asst. Executive Engineer, (Elect)
C, O & M C7 Sub-Division, BESCOM
Yelhanka, Bangalore - 560 064.

THAM VRI

Address

BILL No. **YNK 74684**

DATE: 10/05/16 TIME: AM/PM

TIN : 29330352183
CST No. 01153900 Dt. 10-03-2003

Sl. No.	Description	Quantity	Rate per Pc Rs.	Value Amount Rs.
	Single Phase Static Energy Meter Type : E150, 5-30 Amps			
Sl. Nos.				
3 phase 2M11310.5-30A C208640		1	1650.00	1650.-
on Assistant Executive Engineer, Tarayanapura Sub Division B.E.M.P., Bangalore		VAT @ 14.5 %		239.25
Name of Company BESCOM	DVN. C-8	GRAND TOTAL		1889.25
W.O. No. U-23848	Date 06/05/16			

E.&O.E.

For Landis+Gyr Limited.

For Landis+Gyr Limited.